


# DG-E - Operation and Maintenance of Diesel Power Generating Plants

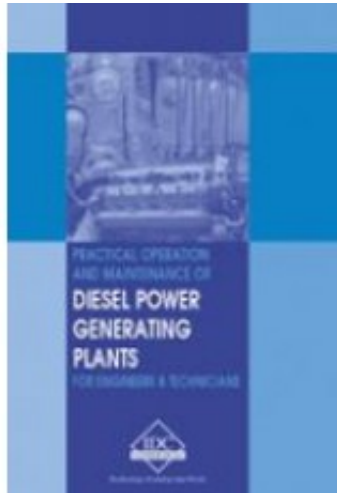

**Availability:** In Stock

**Price: \$139.94**

**Ex Tax: \$127.22**

## **Short Description**

A good knowledge of basic operation principles, layout requirements, associated components and maintenance practices for diesel power plants help the career development of many engineers and technicians in today's world.

## **Description**

A good knowledge of basic operation principles, layout requirements, associated components and maintenance practices for diesel power plants help the career development of many engineers and technicians in today's world.

In this manual, examples are taken from various industrial standard practices for reliable and trouble-free operation of diesel power plants. Some of the essential systems such as fuel oil layouts, lube oil requirements and control circuitry are also discussed.

## **Table of Contents**

Download Chapter List

[Table of Contents](#)

## **First Chapter**

# **Operation and Maintenance of Diesel Power Generating Plants - An Introduction**

## **1**

### **Introduction**

*In this introductory chapter, we will discuss various sources of energy, the generation of electric power and the prime movers for power generation. We will briefly discuss the types of engines used, in particular the diesel engine and its advantages when used as prime mover in power generating plants.*

### **Learning objectives**

- Energy sources
- The choice between AC and DC power
- Single phase vs. three-phase AC power
- Prime movers used for power generation
- Power plant components/types
- Types of engines used in power generation
- Diesel engine and its advantages in power generation applications

### **1.1 Energy sources**

The pioneering experimental work of Michael Faraday on electromagnetism and the dynamo (electrical generator), which he invented, paved the way for today's electrical power systems. The invention of the electric lamp by Thomas Edison was a major breakthrough in promoting the use of this new energy form for residential and commercial applications. The development of electric motors, which could be used as the drive for machinery, gave a further boost to its widespread use in all types of industrial applications. All these led to the establishment of centralized power generation facilities to produce electricity in an efficient way and carry it to human settlements for enhancing the standards of living and quality of life.

Electricity is produced in many different ways in today's world. The generation of electric power primarily involves conversion of some naturally available form of energy (such as chemical energy in a fuel) into electrical energy. It was in the year 1903, just over hundred years ago, that the first steam turbine generator, pioneered by Charles Curtis was put into operation at the Newport Electric Corporation in Newport, Rhode Island. Steam still remains the main energy

transfer medium in many power plants where it is produced by heating water in Steam Generating Units (commonly called 'Boilers') using a variety of fuels. Coal is still one of the major raw materials used for generating the super heated steam required for power plants.

Steam generating units and turbines powered initially by coal, later by oil, natural gas, and now by nuclear fission energy, took a major leap forward in the early decades of the 20th century. Simultaneously, key improvements were made in the design of generators to obtain higher energy efficiencies. By the year 1920, high-pressure steam generators were the state of the art. Initially, the common rate of power generation by steam pressure was 1 kilowatt hour (kWh) per 15 to 20 kg of coal. Within a short time period, this was reduced to around 2 kg of coal needed for producing 1 kWh with high steam pressure turbines.

The energy sources used for producing electrical power are broadly classified as:

- Conventional energy sources
- Non conventional/Renewable energy sources

Though electricity has been discovered for just over a century, dividing power generation sources as conventional and non conventional is due to the fact that there are quite a few sources having different characteristics used for generating electrical power, Power generation using conventional fuels involves combustion of naturally occurring fuels but the latter (renewable energy sources) may or may not require a combustion stage in the conversion process. Conventional energy production processes deplete naturally available resources such as petroleum, coal, etc., in addition to being major pollution contributors.

Electric power produced by various sources is based on the internal energy content per unit weight of the source and is termed in kilocalories per kg in metric units. This is called the calorific energy of the fuel and Table 1.1 lists the calorific values for some of the major sources used today.

**Table 1.1**

***Typical Calorific values***

<b>Fuel</b>	<b>Calorific Value (kCal/kg)</b>
Paraffin	10,400
Diesel Petroleum	9,800
Charcoal	7,100

Dried Wood	4,700
Lignite	4,000
Wood (25-30% Moisture)	3,500

The term non conventional energy generally refers to power generation methods that directly use the energy from natural resources like wind, Sun, etc., without depleting these resources and with minimum or almost zero pollution. These are also termed as renewable energy sources, since these sources do not deplete at the rates of conventional sources. Hydro-electric (hydel) generation is an example of renewable energy and forms one of the most important components of power generation in many countries around the world. Other more exotic methods such as power generation from tidal and wave energy as well as from ocean thermal energy (deploying the temperature gradient of the sea water at different depths) are also under experimentation.

Though non-conventional sources are becoming popular in many countries, the bulk of the power generated today is created by using conventional fuel sources and results in depleting energy reserves. The use of diesel fuels belongs to the conventional generation category. While diesel oil can also be used for producing steam, this manual discusses diesel engine power plants where the electrical power is generated from diesel oil or an equivalent distillate produced from petroleum crude oil by an internal-combustion type of prime mover (engine), similar to those used in transport vehicles.

## **1.2 AC and DC power**

Electrical power that is used in everyday life is broadly divided into two main categories viz., AC (Alternating Current) power and DC (Direct Current) power. In the case of DC power, the electrons flow in only one direction. In the case of AC power, the electrons oscillate back and forth at a defined frequency. Edison's inventions, from the light bulb to the electric fan, were based on DC electricity.

Though DC can be generated using DC machines with rotating armature and stationary field windings, the capacity is limited because of the need for a commutator/brush gear within the machine. Further, transmission of DC power over long distances cannot be as easily achieved as AC power. In today's world DC power is mostly derived from stationary batteries of Lead acid type, Nickel Cadmium type, etc. Naturally the sizes of these DC sources become unmanageable in high power applications. Hence the use of DC power is limited to standby power/ emergency use and starting applications.

Within a short span time since the invention of electricity, the advantages of AC power became apparent. AC power requires simpler and robust generator design and is also very easy to transmit over long distances. Although DC power continues to be used in equipment, it is invariably obtained by conversion. AC power can be readily converted to run DC appliances - another advantage offered by AC power.

The use of AC power became very widespread because of the invention of transformers, which can be used to convert the voltage easily to any desired value. Since transmission of power is more economical at higher voltages, AC power transmission and distribution systems deploying transformers have become the norm in the power industry. Transformers are also very useful as components within equipment where they are utilized to derive lower voltages to suit the application requirements. In modern power systems, transmission of power at high DC voltages has been found to possess specific advantages and is being used increasingly in specific segments. But this is more of an exception than the norm and is yet to attain the preeminent position of AC systems in the power industry. The discussion of the same is beyond the scope of this manual.

### **1.3 Single phase and three-phase AC power**

AC power is again divided into single phase and three-phase power. The first AC generators with a single set of windings and a rotating magnet generated single-phase voltage. Generators with spatially displaced windings generating poly-phase AC voltage were a later development. The advantages of three-phase power and the economy achieved in generation and transmission of electricity were then evident and it became the norm for all AC electrical systems. A single-phase power system results in higher current for transferring a given amount of energy, which increases the size of generators and also the conductors required to carry the current over long distances. Though single phase power is used today both in industries and commercial/residential applications, their usage is limited to final distribution circuits for low capacity devices such as lighting, small pumps, small capacity air conditioners, computers, etc. Again, this single-phase power is actually derived out of the three phase system and does not require any special equipment / devices for separation of three phase power to single phase, when needed.

Today's power plants invariably generate three-phase AC power at hundreds and thousands of Megawatts.

The AC generator in a power plant is coupled to a prime mover, which is made to rotate (move) by its primary energy source, which can be a liquid fuel, gas, water

(in hydroelectric power stations), etc. The prime mover drives the rotor of the generator at the required speed. This in turn produces an alternating voltage at the generator's three output terminals in sinusoidal form, which is the most commonly followed system for generation and transmission. (Zero to peak value to zero to negative peak to zero and repeating the same). The waveform in one of the phases will be as shown in figure 1.1, with time on the X-axis and the voltage value on the Y-axis. The arrow lines by the side of the waveform basically indicate its angular position at that particular time and the instantaneous value of the wave form is given by the vertical line length from the arrow end.

### **Fig 1.1**

#### *Ac sinusoidal voltage and vector representation*

The above variation is termed one cycle with the voltage in one phase represented by a vector line, which makes  $360^{\circ}$  rotation for one full cycle. AC generators produce this kind of sinusoidal voltages at 50 or 60 cycles per second (known as the frequency of the electrical source and expressed in cycles/second or Hertz) in its three phases with B phase lagging A phase by  $120^{\circ}$  and leading phase C by  $120^{\circ}$ . Though the arrows are shown as moving in clockwise direction, it is generally a practice to show the vector traveling in anti clock direction. These three phases A, B and C are represented as three rotating vectors as shown in figure 1.2 below.

“Generator” is a common name used for both AC and DC producing machines. However for a quick understanding, the AC generator is more commonly called “alternator” meaning it produces alternating current, unlike its DC counterpart.

### **Fig 1.2**

#### *Regular anticlockwise phase voltage rotation*

The generator is provided with three independent windings in such a way as to produce the voltages in the above fashion. The windings at one end are brought to terminals A, B and C and the other ends are interconnected to form the neutral end of the generator. Though the windings can also be connected in Delta form, this is not followed in generators. It is also an established practice to connect the neutral terminal to the ground through a resistance called Neutral Grounding

Resistor (NGR) to limit the fault currents in the generator during earth fault. Further, it is to be noted that when multiple generators are connected to supply a common bus, the phase angles A, B and C of all generators shall be exactly same as otherwise it would lead to severe short circuit conditions. The other major parameter to be matched is the terminal voltage of parallel-operated generators, which shall be almost equal.

The power produced by the generator in a power plant is expressed in terms of kilowatts (kW) or megawatts (MW) of electrical power output that basically defines the capacity of the power plant. The frequency of these three phase alternating voltages is directly proportional to the speed at which the generator is made to run with the help of the prime mover. The most common frequencies are 50Hz and 60Hz and vary from one country to another, which means the 60 Hz generator shall have to run faster than a 50Hz generator.

The capacity of an alternator is termed in kVA, which is basically the product of generated voltage kV and the maximum current it can deliver. The current wave form generally lags the generated voltage wave form by an angle and the cosine of this angle is the power factor of the generator. Product of kVA and power factor gives the useful power that can be extracted from the generator for a particular type of load, with the balance power spent to overcome the reactive force of the load. The capacity of a power unit is given in terms of kW (or MW) which is the product of kVA and power factor of the generator, giving the useful power that can be produced from an unit. Where a power plant includes multiple of units, the total capacity of the power plant is the sum of all kW that can be produced by all generators.

The power capacity of the generator is actually related to the maximum shaft power of the engine to which it is couple to. In case of diesel engines, the capacity of the engine is termed in brake horse power (BHP). Though it may be possible to connect a higher kVA generator to the engine, it does not serve any purpose and hence the generator capacity is matched to the engine BHP rating and alternator efficiency that gives the output rating of a power set. . The diesel generator output is also referred in terms of KW or MW (Some times in KWe, MWe to distinguish from the heat load), taking into account the actual power that can be utilized for inductive loads at some power factor (normally 0.80). The output power of a generator is dependent on the mechanical energy input provided by its prime mover i.e. the capacity of the turbine/ engine. However the voltage peak value generated is independent of the prime mover capacity and is mainly dependent on the internal construction of the generator. The effective sinusoidal AC voltage across any two of the terminals of the generator is named the rated voltage of the generator. This effective value is called the RMS value of

the sine cycle and is given by peak voltage divided by  $\sqrt{2}$ .

The main components of the AC generator are:

- Stator
- Rotor
- Exciter/field

It can be indicated that the rated kW/MW power of the plant is produced at the selected generator voltage. Similar to the frequency, the selected voltages of the generators may also vary from one country to another and is normally chosen to match the standard system voltages followed in the country of the plant. The full load current ratings of the alternator decide the size of the conductors to be used in it and hence the alternator size increases with increase in current values. Hence it is customary to design higher kVA alternators to produce higher terminal voltages to minimize the current ( $= \text{kVA/kV}$ ) and also conductor size. The larger the engine capacity, the generator kVA would be higher requiring a higher terminal voltage, to keep the current ratings low. However the upper limit of the alternator terminal voltage is normally limited due to manufacturing constraints which is around 25kV. Beyond this voltage, the generator size becomes very large and difficulties are faced in having insulated windings above this voltage within a compact space. A rated generator voltage of around 11kV to 17.5kV is more commonly adopted in power plants.

This manual covers the generator construction and applications in a subsequent chapter.

## **1.4 Prime movers**

Conventional power generation approach generally involves converting the energy contained in fuels first into thermal energy in a combustion unit, then converting the thermal energy to mechanical energy by a prime mover, with the mechanical energy being converted to electrical energy by the generator. External combustion systems have different equipment for all the three steps of conversion. In internal combustion engine combustion and conversion of thermal to mechanical energy take place within a single equipment unit.

Following are the major prime movers used in conventional power plants.

- Steam turbine
- Reciprocating engine
- Gas turbine.



Steam turbine belongs to the external combustion category whereas the other two examples are of internal combustion type.

Table 1.2 lists the typical prime movers and the power range normally generated.

**Table 1.2**

*Features of Different Prime Movers*

<b>Type</b>	<b>Output Range</b>	<b>Typical Fuels</b>	<b>Typical Heat to Power Ratio</b>	<b>Heat Output</b>
<b>Steam Turbine</b>	0.5MW to 600MW	Any, but used for producing steam	3:1 to 10:1	Medium
<b>Gas Turbine</b>	0.5MW to 250MW	Natural gas, Liquified Gas, Biogas, Mine gas	1.6:1 up to 5:1 with after firing	High
<b>Compression ignition engines</b>	Upto 20 MW	Natural gas with diesel oil, Heavy fuel oil	1:1 to 1.5:1 up to 2.5:1 with after firing	Low and High
<b>Spark Ignition</b>	Up to 4MW	Natural gas, Landfill gas, Biogas, Mine gas	1:1 to 1.7:1	Low and High
Heat Recovery gas turbines	1MW to 100MW	Same as gas turbine	Down to 0.7:1	Medium

The choice of prime mover is based on a number of factors and even with similar energy requirements, no two sites can be the same. The critical factor is the Heat to Power ratio of site demand, which is also listed, in the above table. Ignition Engines are preferred where the electrical power requirement is relatively high as a proportion of total energy of the plant in operation. Conversely where heat demand is typically more than 3 or 4 times electrical demand the turbine begins to have an advantage. Another key factor is the quality of heat required at the customer site. Some industrial processes have little use for low grade heat – the hot water produced in engine based schemes. Where high temperature steam is the primary heat requirement then the turbine is clearly superior.

However where the power requirements are by utility companies, the size of the power plant, access to fuel requirements, local conditions, etc decide the type of power plants. Invariably these units do not require steam as a major selling/utility product and hence these are mostly steam turbines and gas turbines. Engine driven power plants by utility companies are normally restricted, except in oil producing countries, because of the limitation in their sizes.

The following paragraphs give an insight of the major types of prime movers/ power plants.

## Steam Turbines

Steam turbines have been used as prime movers for power plants for many years. The process generally involves production of High-pressure steam in a steam boiler. This steam is expanded within the turbine to produce mechanical energy rotating the turbine, which in turn drives an electric generator. This system generates less electrical energy per unit of fuel than a gas turbine or reciprocating engine-driven cogeneration system. However its overall efficiency may be higher, achieving up to 84% (based on fuel gross calorific value).

For viable power generation, steam input must be at a high pressure and temperature. The plant is capital intensive because a high pressure boiler is required to produce the motive steam. Steam cycles typically produce a large amount of heat compared with the electrical output, resulting in a high cost installation in terms of dollars/kWe.

## Gas Turbines

The gas turbine was the most widely used prime mover for large-scale cogeneration for many years, typically generating 1-100 MWe. Increased findings of gas fields in the second part of the last century have resulted in single turbine capacities exceeding 250MWe. The installation works of a gas turbine based system is much easier than installing steam turbine with high-pressure boiler. Increased availability of gases in many countries has given a boost to standalone gas turbine plants. The space requirements of gas turbine power plants are also considerably lower which is a factor weighing heavily in their favor. This, together with reduced capital cost and improved reliability of modern machines, often makes gas turbines the optimum choice in most of the modern plants.

Gas turbines are provided with compressors as an integral part. The fuel (which is normally natural gas) is burnt in a pressurized combustion chamber using combustion air supplied by the compressor that is integral with the gas turbine. The very hot ( $900^{\circ}\text{C}$ -  $1200^{\circ}\text{C}$ ) pressurized gases are used to turn a series of fan blades and the shaft on which they are mounted, to produce mechanical energy. The available mechanical energy is used to drive a generator to produce electricity, similar to the steam turbine.

### Fig 1.3

*Gas Turbine Generator Components*

A gas turbine generally operates under high speed and high temperature conditions. This necessitates use of high-premium fuels, particularly natural gas. The waste gases exhausted from the gas turbine are also quite high at around 450<sup>0</sup> C to 550<sup>0</sup> C, making the gas turbine particularly suitable for high-grade heat supply. The ratio of usable heat to power varies from 1.5:1 to 3:1 depending on the characteristics of the particular gas turbine. Supplementary firing may also be used to increase exhaust gas temperatures to 1000<sup>0</sup> C or more, raising the overall heat to power ratio to as much as 10:1.

Supplementary firing is highly efficient as no additional combustion air is required to burn extra fuel. Efficiencies of 95% or more are typical for the fuel burned in supplementary firing systems.

Gas turbines are available in a wide power output range from 500 kWe to over 200 MWe, although sets smaller than 1 MWe have been generally uneconomical due to their comparatively low electrical efficiency and consequent high cost per kWe output. The turbine is typically mounted on the same sub-base as its generator, with a step down gearbox between the two to reduce the high shaft speed of the turbine to a speed suitable for the generator related to its frequency output. A gas turbo-generator is extremely noisy due to the use of compressors and generally requires good acoustic enclosures for noise attenuation.

## **Combined Cycle Plants**

It is possible to improve the efficiency of gas turbine installations by using a combination of gas turbine and steam turbine, in which, the hot exhaust gases from the gas turbine are passed through a Heat recovery Steam Generator (HRSG) to produce steam for the steam turbine. Plants employing this kind of mixed generation are called a combined cycle plants.

Gas turbine combined cycle (CCGT) systems are now adopted by utility companies where supplies of natural gas are plentiful. Power stations of up to 1,800 MWe have been constructed with multiple units. In some plants the steam produced is used for process or other heating duties and are named as cogeneration facilities (Electrical power and steam). The main advantage of CCGT cogeneration is its greater overall efficiency in the production of electricity.

### **Fig 1.4**

*Combined Cycle Power Plant (Courtesy: ALSTOM)*

The heat recovery boiler is an essential component of the cogeneration installation. It recovers the heat from the exhaust gases of gas turbines or reciprocating engines. The simplest one is a heat exchanger through which the exhaust gases pass and the heat is transferred to the boiler feed water to produce steam. The cooled gases are then passed through the exhaust pipe or chimney and are discharged into the atmosphere. In this case, the composition or constituents of the exhaust gases from the prime mover are not changed. The exhaust gases discharged contain significant quantities of heat but all can not be economically recovered with a boiler. One typical feature of the exhaust heat boiler (or waste heat recovery unit) is that the typical size is bigger than a conventional fuel-burning unit. This is because the lower exhaust gas temperatures require a greater heat transfer area in the boiler. It shall be ensured that excessive flow resistance in the exhaust gas stream is avoided as this can adversely affect the normal operation of the turbine or engine and its overall efficiency.

## **Reciprocating Engines**

The diesel engines are basically reciprocating engines. Although conceptually the system differs very little from that of gas turbines, there are important differences. Reciprocating engines have a higher energy efficiency but the thermal energy they produce is generally at lower temperatures and is dispersed between exhaust gases and cooling systems. Hence heat recovery systems are uncommon in power plants employing reciprocating engines.

### **Fig 1.5**

#### *An Industrial skid mounted Diesel Generator*

The usable heat power ratio range is normally in the range 0.5:1 to 2:1. However, as the exhaust contains large amounts of excess air, supplementary firing is feasible, raising the ratio to a maximum of 5:1.

There are two types of reciprocating engines commonly used for power generation,

- Compression-ignition ('diesel') engines – These are available as engines using diesel fuel as well as dual fuel type in which a small quantity of gas oil (about 5% of the total heat input) is injected with the gas to ensure ignition. Exhaust temperatures are often lower, typically 85<sup>0</sup>C maximum,

thereby limiting the scope for heat recovery. Compression-ignition engines run at speeds of between 500 and 1500 rev/min. In general, engines up to about 500 kWe (and sometimes up to 2 MWe) are derivatives of the original automotive diesels, operating on gas oil and running at the upper end of their speed range. Engines from 500 kWe to 20 MWe evolved from marine diesels and are dual-fuel or residual fuel oil machines running at medium to low speed.

- Spark-ignition engines – These are equivalents of diesel engines and have their same parameter equivalents as 90°C cooling water. Traditionally, shaft efficiency is lower than compression ignition engines. The output of a spark-ignition engine is a little smaller, typically 83% of the diesel engines. They are suited to smaller, simpler cogeneration installations, often with cooling and exhaust heat recovery cascaded together with a waste heat boiler providing medium or low temperature hot water to site. Spark-ignition engines operate on clean gaseous fuels, natural gas being the most popular. Exhaust fumes can be used directly in certain processes, such as drying, CO<sub>2</sub> production, etc.

Reciprocating machines by their nature have more moving parts, some of which wear more rapidly than those in normal rotating machines. These require running as well as shutdown maintenance for trouble free performance. Nevertheless, reasonably well-maintained sets can provide typical availability of about 90-95%, which makes them very attractive for industrial consumers.

## **1.5 Power plant components/types**

The main components of any power plant are as below.

- Prime Mover
- Generator
- Fuel storage and handling system
- Cooling system
- Exhaust system
- Electrical substation and control

A power plant is generally known by the type of prime mover used to produce electric power. The other systems referred above are mostly support or auxiliary services to ensure efficient operation of the prime mover and for transferring the power efficiently. The prime mover is coupled to the generator directly or through

gear boxes to produce the electric power.

The various prime movers commonly used to rotate a generator for electricity production are:

- Gas Turbines
- Steam Turbines
- Hydel Turbines
- Diesel Engines
- Gasoline Engines
- Heavy fuel engines, etc.

As can be noted, 'turbine' and 'engine' are the most common terms used to identify a prime mover. Table 1.3 compares the features of the various power generation methods presently in vogue.

**Table 1.3**

***Features of Different power generation methods***

<b>Fuel/Prime mover</b>	<b>Advantages</b>	<b>Disadvantages</b>	<b>Remarks</b>
Coal	<ul style="list-style-type: none"> <li>• Economical</li> <li>• Good availability in many countries</li> </ul>	<ul style="list-style-type: none"> <li>• Cost not favourable for smaller sizes</li> <li>• Coal properties not uniform and calorific values differ.</li> <li>• More carbon dioxide (CO<sub>2</sub>) per kWh of energy than any other generation method</li> <li>• Ash disposal issues.</li> <li>• Increased sulphur content in some types produce sulphur dioxide and eventually sulphuric acid that can cause acid rain.</li> </ul>	<p>Coal being one of the main fuels used for long time and hence still considered as a good fuel for generation though it does not have any space advantage over several other generation methods.</p>
Natural gas	<ul style="list-style-type: none"> <li>• Lower capital cost.</li> </ul>	<ul style="list-style-type: none"> <li>• Cost not favourable for</li> </ul>	

	<ul style="list-style-type: none"> <li>Compact sizes.</li> </ul>	<ul style="list-style-type: none"> <li>smaller sizes</li> </ul>	
	<ul style="list-style-type: none"> <li>Lesser CO<sub>2</sub> produced compared to coal or oil</li> </ul>	<ul style="list-style-type: none"> <li>Natural gas reserves are limited and many times location closer to gas field is preferred in case of low availability.</li> </ul>	
Oil	<ul style="list-style-type: none"> <li>Lower cost</li> <li>Compact Generators</li> <li>Produces less CO<sub>2</sub> than coal</li> </ul>	<ul style="list-style-type: none"> <li>Limited oil reserves.</li> <li>Oil spills, especially at sea, cause severe pollution</li> <li>Some oils contain high levels of sulphur resulting in Sulphur dioxide and acid rains.</li> </ul>	<ul style="list-style-type: none"> <li>Oil price increase causing major concerns in power cost.</li> </ul>
Hydel	<ul style="list-style-type: none"> <li>Compact size</li> <li>Pollution free</li> </ul>	<ul style="list-style-type: none"> <li>Ecological unbalance due to large dams</li> <li>Dislocation of population for constructing dams.</li> </ul>	
Nuclear	<ul style="list-style-type: none"> <li>Compact size</li> </ul>	<ul style="list-style-type: none"> <li>Expensive</li> <li>Radiation release issues</li> <li>Plutonium used can be an indirect contributor for nuclear bombs</li> <li>Disposal of radio active materials</li> </ul>	
Wind Turbines	<ul style="list-style-type: none"> <li>Non-polluting</li> </ul>	<ul style="list-style-type: none"> <li>Dependent on wind</li> <li>Needs utility companies' backup</li> </ul>	
Diesel and petrol powered generators	<ul style="list-style-type: none"> <li>Small in size</li> <li>Relatively low cost</li> <li>Portability</li> </ul>	<ul style="list-style-type: none"> <li>Major noise and CO<sub>2</sub> producers.</li> <li>Fuels which are limited in availability</li> </ul>	<ul style="list-style-type: none"> <li>Petrol engine limited around 5 or 10kW.</li> <li>Diesel units are employed for higher sizes.</li> </ul>

Solar photovoltaic (Solar electrical panels)	·	Faster installation time	·	Higher capital cost	More useful in off s installations.
	·	Abundant source	·	Mainly DC power and hence limited for smaller size units.	
	·	Non polluting	·	High area requirements for large capacities.	
	·	More useful for isolated locations	·	Need alternate power during nights and no sun days	
			·	Cost of generation is high compared to other methods	

In this manual we will cover the Diesel Engine operated power plants viz., diesel power plants which are used to generate Electrical power. Today diesel engines are available in many sizes but engines used for three phase power generation are mostly in the range of 7.5 kW to around 20000 kW.

## 1.6 Engine types

Engines may be classified as internal combustion engines and external combustion engines. Though external combustion is not common terminology, the basic steam turbine that is used in many power plants can be termed an external combustion engine. Here the power is generated by combusting the fuel external to the prime mover to produce steam, which is used by the turbine to generate power.

An internal combustion engine is an [engine](#) that is powered by the expansion of hot combustion products of [fuel](#) directly burnt within the engine. The internal combustion diesel engine is piston operated, also called reciprocating. The internal combustion engine works by burning [hydrocarbon](#) or [hydrogen](#) fuel that is compressed by the piston action.

There are two primary reciprocating engine designs relevant to electrical power generation applications



- Spark ignition Otto-cycle engine
- Compression ignition Diesel-cycle engine.

The essential mechanical components of the Otto-cycle and Diesel-cycle are the same. Both the engines use a cylindrical combustion chamber in which a close fitting piston travels the length of the cylinder. The piston connects to a crankshaft that transforms the linear motion of the piston into the rotary motion of the crankshaft. Most engines have multiple cylinders that power a single crankshaft.

Spark ignition engines typically use a gaseous fuel such as natural gas or propane. Compression ignition engines typically use a liquid fuel such as Diesel. There are advantages and disadvantages to both in: fuel type, fuel consumption, power output, maintenance requirements and air emissions.

The primary difference between the Otto and Diesel cycles is the method of igniting the fuel. Spark ignition engines (Otto-cycle) use a spark plug to ignite a pre-mixed air fuel mixture introduced into the cylinder. Compression ignition engines (Diesel-cycle) compress the air introduced into the cylinder to a high pressure, raising its temperature to the auto-ignition temperature of the fuel that is injected at high pressure. The spark ignition engines usually have lower compression ratios. If the compression ratio of a spark engine is equal to that of compression ignition, uncontrolled combustion will result.

An engine's capacity is the [displacement](#) or swept volume by the pistons of the engine. It is generally measured in liters or cubic inches for larger engines and cubic centimeters (abbreviated to cc) for smaller engines. Engines with greater capacities are usually more powerful and provide greater torque at lower rpm's but also consume more fuel.

Apart from designing an engine with more cylinders, there are two ways to increase an engine's capacity. The first is to lengthen the stroke and the second is to increase the piston's diameter. In either case, it may be necessary to make further adjustments to the fuel intake of the engine to ensure optimal performance.

## **Spark ignition engines**

The technology for spark ignited engines is based on natural gas fuel. These engines are bifurcated into two primary designs; lean burn and rich burn engines. The advantage of a lean burn engine is its greater fuel efficiency due to its inherently lower engine knock tendency and higher compression ratio. Since

there is excess air during the combustion process, the CO emission level is also very low. The disadvantage of lean burn technology is the production of NO<sub>x</sub>. Although, the NO<sub>x</sub> production is lower in a lean burn engine than in a rich burn engine, it is very difficult and expensive to reduce the NO<sub>x</sub> level from a lean burn engine with emission after-treatment systems. These systems use reagent-based NO<sub>x</sub>-reduction catalysts or Selective Catalytic Reduction ("SCR") where ammonia or urea is added to the exhaust system. This requires a separate storage tank with additional operation costs.

Benefits of a lean burn engine compared to a rich burn engine:

- Greater fuel efficiency
- Lower emissions
- Higher power density

Rich burn engines compared to lean burn engines of the same size and configuration have only one advantage, the potential application of a Non Selective Catalytic Reduction ("NSCR") after treatment system. This technology has been commonly used in automotive applications for many years and is proven to reduce emissions by over 90% (CO, NO<sub>x</sub>, unburned Hydrocarbons). It is also considered relatively inexpensive compared to other methods.

## **Compression ignition engines**

Compression ignition engines are commonly called diesel engines, named after its inventor (Rudolf Diesel) who, in 1898, developed an engine using the principle of compression ignition. Since then, the fuel commonly used in the compression ignition engines or diesel engines has also been named "diesel fuel" though heavy fuels have been found to be more economical in operating diesel power plants in the last two/three decades.

The major features of the diesel engine are its ability to start quickly, pick up a large electrical load and run on a variety of stored liquid fuels. The greatest drawback to diesel engines is the high exhaust emissions. The emission quality typically is much poorer than that of a comparable spark ignition engine running on natural gas.

Compression ignition engines can also be fueled by a blend of diesel fuel with another fuel such as natural gas. These engines are commonly known as dual fuel engines.

The advantage of dual fuel engines are:

- Lower air emissions than a regular diesel engine
- Power density of a diesel engine
- Lower operating costs

Diesel engines have historically been the most popular type of reciprocating engine for both small and large power generation applications.

## 1.7 Diesel power plants

Diesel power plants comprise of diesel engines and other support systems typical of any power plant. Following paragraphs describe the basic components of the diesel engine and also the basic features of the support systems that are mostly common in an industrial atmosphere. These basic components and support systems will be covered in detail in the following chapters.

### Engine components

The following are the essential components of an engine.

- **Drive train:** Basically refers to the pistons, connecting rods, crankshaft, flywheel, coupling, if any, and associated bearings of the engine.
- **Valve train and timing:** Includes the gearing from the crankshaft to the camshaft, Camshaft itself, push rods, rocker arms, valves, valve springs, and guides. The camshaft controls the fuel injection timing and actuates the injector in most of the engines with unit injectors in four-cycle engines. Two-cycle engines move air into the cylinder and exhaust out through ports in the cylinder wall which are exposed by the movement of the piston. Some two-cycle engines have both ports and valves. Injection timing and actuation on two-cycle engines are still controlled by a camshaft.
- **Governor/control.** The governor is a sophisticated device that controls the speed of the engine by varying the fuel input. The engine speed droops down when the load increases. A reverse phenomenon occurs when the load is suddenly thrown out. The governor gets the crankshaft speed feedback and reacts to small deviations in the speed due to the load changes and maintains proper engine speed by adjusting the amount of fuel injected. Two types of governors are more common on diesel engines driving electric generators. The earlier version was a: self-contained mechanical-hydraulic type which is still under use. Developments in Electronics field have resulted in development of electronic governor with separate engine-mounted actuator. Multiple generating sets use Electronic governor systems to ensure proper load

sharing. Pulsating loads of some facilities have dictated the use of mechanical governors. Plants adopting multiple engines must have compatible governors in each of them to ensure proper operation of engines in parallel.

- Turbocharger/blower: This is basically a centrifugal compressor, which is driven by the exhaust gases and in turn compresses the intake air to provide an increased mass of air to the combustion chamber. In-line engines typically have one turbocharger, and V type engines may adopt one or two turbochargers. Turbochargers are used on both two and four stroke engines, but many two stroke engines utilize blowers to assist in scavenging air from the combustion chamber without significant increase in the density of the air.
- After cooler: Turbocharged engines have an after cooler downstream of the turbocharger basically to reduce the air temperature and increase the density of the air entering the combustion chamber. Cooling water is circulated through the after cooler, which is composed of finned tubes to cool the air to approximately 40° C.

## **Engine supporting systems**

The engine generating set requires a number of supporting systems. These are discussed below.

- Generators: AC generators are the main driven equipment for diesel engines in power plants. The diesel engine and the generator are generally coupled either directly or by means of a flexible coupling and correct alignment of the coupling is very critical for proper performance. It is important that the engine output and generator output are properly matched and a torsional analysis of the engine/generator system is performed by the engine manufacturer to ensure that there is no torsional resonance leading to shaft failures..
- Fuel oil systems: Like any prime mover, the fuel system is very important for continuous operation of the engine. The fuel oil must have the proper characteristics required for the specific engine installation. In general, less volatile fuels are employed for larger slow-speed engines while a more volatile fuel satisfies the performance of the smaller high-speed engines. Recent use of heavy fuel oils calls for special engine construction to meet the different characteristics of these fuels.
- Lube oil systems: All rotating machines require proper lubricating oil for satisfactory performance and prolonged life of the moving parts and diesel engines are no exception. Normally the manufacturer recommends the type of lube oil based on the fuels used and the engine

characteristics. The lube oil must be analyzed at periodic intervals and changed based on the results of the analysis. The lube oil analysis also gives indirect indication of the problems or a need for maintenance of the moving parts. The analysis of the lube oil in large continuous plants should include trace metal analysis for early indication of abnormal wear to schedule maintenance or repairs, as needed. Lube oil systems are generally transferred from an internal sump of the engine generator set assembly cool and filters are used to provide proper lubrication and cooling of critical components within the engine.

- Engine air system: The engine intake and exhaust systems provide filtered air to the engine and remove products of combustion from the engine room respectively. These systems incorporate such features as preheating or pre-cooling of the intake air based on the plant sizes and the number of units in operation. Restrictions or blockage of the intake or exhaust system will severely hamper the engine performance. Pollution control requirements in many counties require installation of very tall chimneys for exhaust systems to ensure safe disposal of waste gases.
- Engine cooling system: The engine cooling system may consist of a single circuit which removes heat from the after cooler and lube oil cooler, as well as the engine, or it may have separate circuits which allow lower temperatures to be maintained at the various components. Radiator (Air) cooling is common for smaller sizes of around 500kW or less. The heat is usually rejected directly through a radiator or indirectly via a heat exchanger to a cooling tower. The cooling system temperature is thermostatically maintained to ensure proper cooling and avoid thermal shock of high-temperature components. The heat removed from the engine may be used to preheat combustion air in severe cold climates to improve the combustion process and also used for heating the power plant building in bigger power units.
- Engine starting air system: Majority of diesel engines installed in power plants are started with compressed air, though batteries are common for smaller size units used for industrial use. Compressed air is directed by a distributor directly into the combustion chamber or is provided to an air motor which rotates the engine. Dedicated compressors typically provide starting air at 250 psig. The system (either battery or air) must provide adequate storage to allow multiple attempts to start the engines.
- Engine control systems: The basic control of the engine is maintained by the governor during operation, and the control is independent for each engine. Possible control options range from local or manual starting and synchronization of each engine to automatic starting, synchronization, and load sharing of the engine generators.
- Instrumentation: In earlier days, generating plants used analog devices

for measurement and control purposes. However many new plants now have automated data logging systems which can also provide warnings for out-of-tolerance conditions and historical records of unusual events which can improve the operation of the overall facility and support systems. Regardless of the type of system, data collection provides the basis for trend analysis, which can indicate potential problems before they become severe.

- Ventilation system: Diesel engines operate at high temperatures and, therefore, reject large amounts of heat to the surrounding space. Diesel power plants are typically ventilated to remove this heat and to maintain engine room temperatures within acceptable limits for both personnel and equipment. Proper operation of ventilation systems is required to avoid excessive temperatures, reduced equipment capacity, and potential equipment failures.

## **Typical operation**

Following are the various steps involved in starting up a diesel power unit.

- Initially the engine pre-lube pump should be run to ensure proper lubrication of the bearing surfaces. Where the engines remain idle like in standby/ emergency units, the pre-lube pump should be operated at regular intervals to keep the engine in "ready to start" condition. All engine auxiliary systems should be periodically checked to verify proper status for engine operation. Failure to properly pre-lube the engine prior to starting can result in damage to the internal components of the engine and significantly decrease engine life.
- The engine should then be started without any load connected to the generator (By keeping its main circuit breaker in open condition) and brought up to operating temperature before load is applied. The lube oil pressure shall be verified for normal range immediately after starting.
- Under normal circumstances, the engine loads are generally restricted between 50 percent to 100 percent load for extended periods of time. Operation at lower loads can cause carbon formation and rapid deterioration of the lube oil. Operation at high loads results in higher temperatures and pressures in the combustion chamber and can lead to more frequent maintenance or replacement of components. Priority should be given to maintaining correct lube oil and coolant levels and checking the pressure difference across the inlet air filters, fuel filters and lube-oil filters.
- Diesel engine should be unloaded and allowed to cool down prior to shutdown of the unit. The engine should be operated without load at rated

speed for some time until the exhaust temperature decreases to recommended level and then at low idle speed for about five minutes without load or as directed by manufacturer.

## **1.8 Advantages of diesel power generation**

Reciprocating engines are well suited to a variety of distributed generation applications. Commercial and institutional facilities commonly use diesel engines for their emergency power generation. The majority of industrial facilities also use the diesel engines for emergency applications, though use of diesel engines for continuous duty is more common in some process plants.

The major advantages of Reciprocating engines are

- Their installation time is very fast
- They start quickly when needed
- They follow the load well
- They have good part-load efficiencies
- They also ensure high reliability.
- Comparatively lower capital cost

In many cases, multiple reciprocating engine units are used to increase overall plant capacity and ensure better availability. Reciprocating engines have higher electrical efficiencies than gas turbines of comparable size resulting in lower fuel-related operating costs. In addition, the capital investments needed for installing reciprocating engine generating sets are generally lower than the capital cost for installing gas turbine generating sets up to 3-5 MW in size.

Though the reciprocating engine maintenance costs are generally higher than comparable gas turbines, the maintenance activities are invariably handled by in-house staff or provided by local established service organizations, making them attractive for industrial purposes.

Potential distributed generation applications for reciprocating engines include standby, peak shaving, grid support, and CHP (Combined Heat and Power) applications in which hot water, low-pressure steam, or waste-heat-fired absorption chillers are required. Reciprocating engines are also used extensively in applications such as water pumping, air and gas compressors and chilling/refrigeration, with the engines directly coupled to these machines thereby using the mechanical energy directly.

One of the major advantages of the diesel engine is its adaptability to different

types of fuel varying from natural gas to light fuels to heavy residues (crude and furnace oils). They are also capable of burning liquid fuels derived from plants and biological wastes. Highly promising trials of community based generating plants based on bio fuels are underway in many countries and they are expected to give suitable alternative to the depleting oil reserves.

## **1.9 Summary**

Electricity is produced in many different ways in today's world. It primarily involves conversion of some naturally available form of energy into electrical energy. Steam generating units and turbines powered initially by coal, later by oil, natural gas, and eventually by nuclear fission energy produce the bulk of electrical energy required all over the world. Power generation, transmission and distribution are done using 3-phase AC power. Power generation can either be done using conventional fuels or by renewable energy sources. The former involves combustion but the latter may or may not require a combustion stage in the conversion process.

Conventional power generation approach generally involves converting the energy contained in fuels first into thermal energy in a combustion unit, then converting the thermal energy to mechanical energy by a prime mover, with the mechanical energy being converted to electrical energy by the generator. External combustion systems have different equipment for all the three steps of conversion. In internal combustion engine combustion and conversion of thermal to mechanical energy take place within a single equipment unit. The diesel engine is one of the most versatile of internal combustion engines and is widely used in power generation. It is also considerably more efficient compared to the other alternative methods and has several practical advantages when used in certain types of power generation applications. We will discuss various aspects of Diesel Generating (DG) units in the chapters that follow.